

## Requirements for Small Systems on Monthly Monitoring

### WHO DOES THIS FACTSHEET APPLY TO?

ALL PUBLIC WATER SYSTEMS (PWSs), REGARDLESS OF SOURCE, THAT SERVE 1,000 PEOPLE OR FEWER and collect at least one routine total coliform (TC) SAMPLE MONTHLY.

### RTCR

#### What to Do?

##### Step 1

Develop/update your sample siting plan.

##### Step 2

Collect your drinking water samples.

##### Step 3

Conduct required actions.



#### Additional RTCR

##### Factsheets:

- Requirements for Small Systems on Quarterly Monitoring
- Repeat Monitoring Requirements for Small Systems
- Level 1 & Level 2 Assessments and Corrective Actions

FOR ASSISTANCE, PLEASE

CONTACT DOH - HILLSBOROUGH:

NAME.: KATHY NORMAN

PHONE:813-307-8059 EXT. 5938

NAME: THERESE LADOUCUER

PHONE:813-307-8059 EXT. 5934

#### ATTENTION!

All PWSs must comply with the RTCR requirements starting April 1, 2016.

### STEP 1: DEVELOP/UPDATE YOUR SAMPLE SITING PLAN\*

Contact DOH -Hillsborough @ 813-307-8059.

- **DEVELOP A SAMPLE SITING PLAN AND HAVE IT READY FOR USE BY APRIL 1, 2016.** If you already have a sample siting plan for the Total Coliform Rule (TCR), update this plan to meet the requirements of the RTCR.
  - **LIST THE LOCATIONS WHERE YOU WILL TAKE YOUR SAMPLES (ROUTINE AND REPEAT):** Any repeat sampling location that is also used for GWR triggered source water monitoring must be included.
  - **INCLUDE YOUR ROUTINE COLLECTION SCHEDULE:** For example, “[PWS\_ID] will collect one routine total coliform sample every first Monday of the calendar month.”
  - **UPDATE TO REFLECT CHANGES AT YOUR PWS:** The sample siting plan is a living document and should be updated to reflect changes at your PWS such as: major changes in population; a new or additional water source; infrastructure changes, such as a change in the distribution system (i.e. extended/abandoned lines) or pressure zones; or changes in disinfection or other treatment.

### STEP 2: COLLECT YOUR DRINKING WATER SAMPLES


Know your RTCR routine sampling requirements.

- **COLLECT AT LEAST ONE 100 ML** routine distribution drinking water sample every calendar month.
- **Collect at least one 100 ML** source water sample from each source every calendar month.
- **IMMEDIATELY SEND YOUR SAMPLE TO A STATE-CERTIFIED LAB** that performs total coliform drinking water analyses.
  - Remember the lab must begin analyzing the drinking water sample no later than the 30th hour from the collection time.
  - If necessary, ship the sample overnight and refrigerate or ice the sample using “blue” ice (cooled to about 4° to 10° C).

#### NOTE

\* The sample siting plan is subject to review and revision by the Florida Department of Health - Hillsborough County.

## STEP 3: CONDUCT ACTIONS REQUIRED AS A RESULT OF YOUR SAMPLING

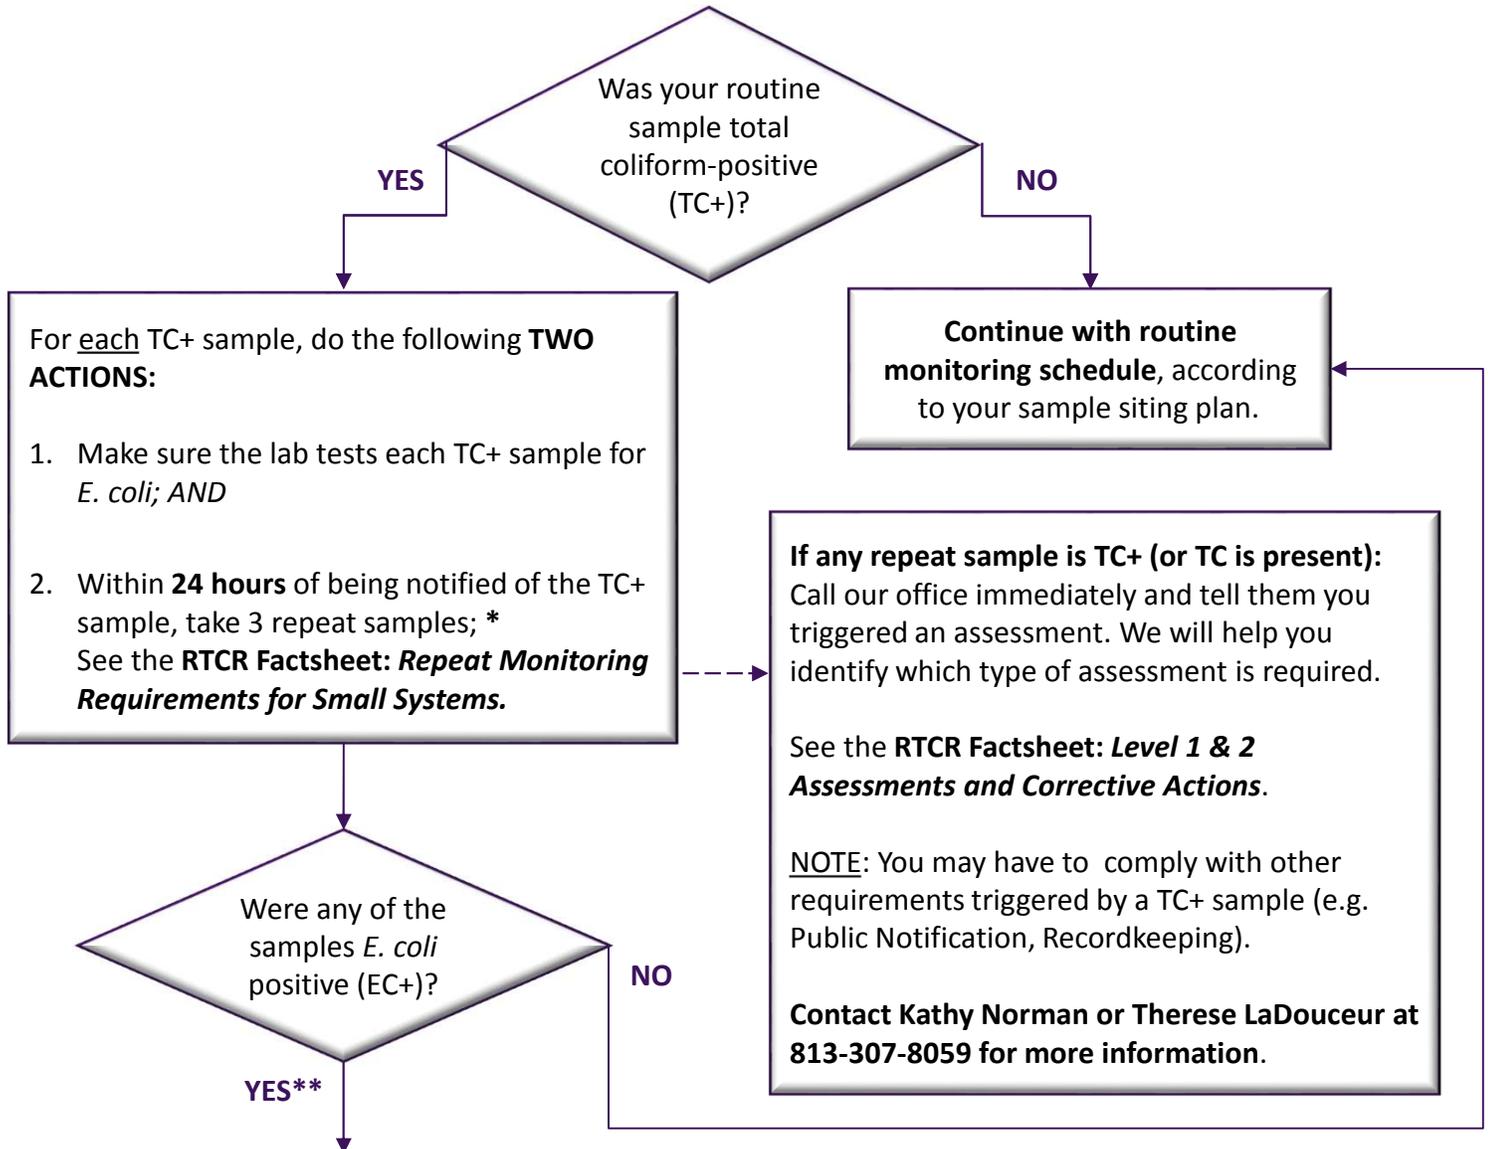

**Call Kathy Norman or Therese LaDouceur @ 813-307-8059!** You have to perform a Level 2 Assessment if the PWS has any of the following occurrences:

- TC+ Routine and EC+ Repeat sample;
- EC+ Routine and TC+ Repeat sample;
- The PWS fails to take and analyze all 3 required repeat samples following an EC+ routine sample; or,
- The PWS fails to test for *E. coli* when any repeat sample is TC+.

Within **30 days** after you learned your PWS has triggered an assessment, a completed assessment form must be submitted to DOH - Hillsborough. See the **RTCR Factsheet: Level 1 & 2 Assessments and Corrective Actions**.

### **NOTES**

\* If you are missing any routine or repeat sample, contact DOH - Hillsborough.

\*\* Call DOH - Hillsborough on the same day you learn of the EC+ result, or by the end of the next business day and tell them you received an EC+ result.